RTE-P1, -P2, -B1, -B2 ALL MULTI-TIMERS **INSTRUCTION SHEET**

Read this instruction sheet to make sure of correct operation before starting installation, operation, maintenance, and inspection of the RTE series timers. The end user should keep this instruction sheet for future reference.

TIME RANGE Determined by Time Range Selector

and Diai	and Diai Selector (hr: hours)											
Dial Range	0-1	0-3	0-10	0-30	0-60							
s	0.1sec - 1sec	0.1sec - 3sec	0.2sec - 10sec	0.6sec - 30sec	1.2sec - 60sec							
min	1.2sec - 1min	3.6sec - 30min	12sec - 10min	36sec - 30min	1.2min - 60min							
h	1.2min - 1hr	3.6min - 3hr	12min - 10hr	36min - 30hr	1.2hr - 60hr							
10h	12min - 10hr	36min - 30hr	2hr - 100hr	6hr -300hr	12hr -600hr							

GENERAL SPECIFICATIONS

Operatio	n Syst	tem		Solid-state CMOS circuit						
Operation	n Typ	е		Multi-Mode						
Time Ra	nge			0.1sec to 600h	ours					
Pollution	Degre	e		2 (IE60664-1)						
Over vol	tage c	ategory		III (IE60664-1)						
Rated O	peratio	nal	AF20	100-240V AC(50/60Hz)						
Voltage			AD24	24V AC(50/60Hz)/24V DC						
			D12	12V DC						
Voltage	Tolera	nce	AF20	85-264V AC(50)/60Hz)					
	AD2		AD24	20.4-26.4V AC	(50/60H	z)/21.6-26	S.4V DC			
	D12			10.8-13.2V DC						
Input off V	'oltage			Rated Voltage	× 10%	minimum				
Ambient	Opera	ting		-20 to +65°C (v	vithout f	reezing)				
Tempera	ture									
Ambient	Storag	ge and		-30 to +75°C (v	vithout f	reezing)				
Transpor		<u> </u>	!							
Relative	Humid	lity		35 to 85%RH (v	vithout c	ondensati	on)			
Atmosph	eric Pr	essure		80kPa to 110kF						
				70kPa to 110kF	Pa (Tran	sport)				
Reset Tir	ne			100msec maxir	num					
Repeat E	rror			±0.2%, ±20ms	6, ±20msec*					
Voltage E				±0.2%, ±20ms	ec*					
Tempera		rror		±0.5%, ±20ms						
Setting E	rror			±10% maximum						
Insulation				100MΩ minimum (500V DC)						
Dielectric	Dielectric Strength			Between power and output terminals: 2000V AC, 1 minute Between contacts of different poles: 2000V AC, 1 minute Between contacts of the same pole: 1000V AC, 1 minute						
Vibration	Resist	ance		10 to 55Hz amplitude 0.5mm 2 hours in each of 3 axes						
Shock Re	sistan	ce		Operating extremes: 98m/sec² (10G) Damage limits: 490m/sec² (50G) 3 times in each of 3 axes						
Degree o	f Prote	ction		IP40 (enclosure), IP20	(socket)	(IEC60529)			
Power	TYPE			RTE-P1, -B1		RTE-P2,	-B2			
Consum-	AF20	120V A	C/60Hz	6.5VA		6.6VA				
ption (Approx.)		240V A		11.6VA		12.1VA				
(.pp.ox.)	AD24	(AC/DC)	3.4VA/1.7W		3.5VA/1.7	7W			
	D12	1.4		1.6W		1.6W				
Mounting	Positio	on		Free						
Dimensio	ns	RTE-P1	, P2	40H×36W×77						
		RTE-B1	, B2	40H×36W×74	.9D mm					
Weight (A	pprox.	.)		RTE-P1	RTE-F	2	RTE-B1, -B2			
			ſ	87g	89g		85q			


For the value of the error against a preset time, whichever the largest applies.

APPLICABLE STANDARDS

UL508, CSA C22.2 No.14, IEC61812-1, EN61812-1

EMC			
Electrostatic Discl	harge	level 3 Contact±6.0kV, Air±8.0kV	IEC61000-4-2 EN61000-4-2
Electromagnetic Field		level 3 10V/m, AM 80%, 80M-1000MHz	IEC61000-4-3 EN61000-4-3
Fast Transient/Bu	rst	level 3 Power Supply: ±2.0kV	IEC61000-4-4 EN61000-4-4
Surge	AF20	level 3 Power Supply: Line to Line ±1.0kV Line to Ground ±2.0kV	IEC61000-4-5 EN61000-4-5
	AD24 D12	level 2 Power Supply: Line to Line ±0.5kV Line to Ground ±1.0kV	
Radiated Emission	n	Group 1 Class A	CISPR 11 EN55011

TYPES



peration mode

1: No Control Signal

2: Control Signal

A: ON-Delay 1

B: Interval

C: Cycle 1

D: Cycle 3

E: Signal ON/OFF-Delay


E: Signal OFF-Delay B: Blade

F: One-Shot

CONTACT RATINGS

Contact Configuration	1	2 Form C, DPDT (Delay output)				
Allowable Voltage / /	Allowable Current	240V AC, 30V DC / 10A				
Maximum Permissible	Operating Frequency	1800 cycles per hour				
Rated Load	Resistive	10A 240V AC, 30V DC				
	Inductive	7A 240V AC, 30V DC				
	Horse Power Rating	1/6 HP 120V AC, 1/3 HP 240V AC				
Conditional Short Cir	cuit	Fuse 10A, 240V				
Life	Electrical	500,000 op. minimum (Resistive)				
	Mechanical	50,000,000 op. minimum				


TEMPERATURE DERATING CURVES

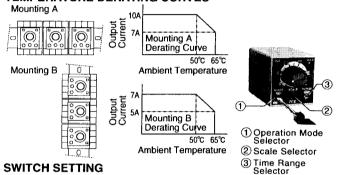

SWITCH SETTING

- (1)Turn the selectors securely using a flat screwdriver 4mm wide maximum. Note that incomplete setting may cause malfunction. Do not turn the selectors beyond the limits.

 (2)Since changing the setting during timer operation may cause malfunction, turn power off before changing the setting.



Safety Precautions

Special expertise is required to use the Electronic Timer.

- All Electronic Timers are manufactured under IDEC's rigorous quality control system, but users must add a backup or fail safe provision to the control system using the Electronic Timer in applications where heavy damage or personal injury may be caused in case the Electronic Timer should fail.
- Install the Electronic Timer according to instructions described in this
- Instruction sheet and the catalog.

 Make sure that the operating conditions are as described in the catalog. If you are uncertain about the specifications, contact IDEC in advance. In this instruction sheet, safety precautions are categorized in order of
- importance to Warning and Caution.

✓ Warning

Warning notices are used to emphasize that improper operation may cause severe personal injury or death.

- Turn power off to the Electronic timer before starting installation, removal,
- wiring, maintenance, and inspection on the Electronic Timer.
 Failure to turn power off may cause electrical shocks or fire hazard.
 Do not use the Electronic Timer for an emergency stop circuit or interlocking circuit. If the Electronic Timer should fail, a machine disorder, breakdown, or accident may occur.

Caution

Caution notices are used where inattention might cause personal injury or damage to equipment.

- The Electronic Timer is designed for installation in equipment.
 Do not install the Electronic Timer outside equipment.
- Do not install the Electronic Timer outside equipment.

 Install the Electronic Timer in environments described in this instruction sheet and the catalog. If the Electronic Timer is used in places where the Electronic Timer is subjected to high-temperature, high-humidity, condensation, corrosive gases, excessive vibrations, and excessive shocks, then electrical shocks, fire hazard, or malfunction will result. Use an IEC60127-approved fuse and circuit breaker on the power and output line outside the Electropic Timer.

- output line outside the Electronic Timer.

 Do not disassemble, repair, or modify the Electronic Timer.

 When disposing of the Electronic Timer, do so as an industrial waste.

IDEC IZUMI CORPORATION http://www.idec.com Instruction Sheet B-766-0 June 2003

OPERATION CHART

RTE-P1, -B1


A: ON-Delay 1 (power start)

Set timer for desired delay, apply power to coil. Contacts transfer after preset time has elapsed, and remain in transferred position until timer is reset. Reset

ltem	Terminal No.	Operation							
Power	(1)2-7 (2)A-B								
Delayed	(1)1-4,5-8 (2)1-7,3-9 (NC)								
Contact	(1)1-3,6-8 (2)4-7,6-9 (NO)								
	PWR								
Indicator	оит								
Set Time									

C: Cycle 1 (power start, OFF first)

Set timer for desired delay, apply power to coil. First transfer of contacts occurs after preset delay has elapsed, after the next elapse of preset delay contacts return to original position. The timer now cycles between on and off as long as power is applied (duty ratio 1:1).



B: Interval (power start)

Set timer for desired delay, apply power to coil. Contacts transfer immediately, and return to original position after preset time has elapsed. Reset occurs with removal of power.

ltem	Terminal No.	Operation							
Power	(1)2-7 (2)A-B								
Delayed	(1)1-4,5-8 (2)1-7,3-9 (NC)								
Contact	(1)1-3,6-B (2)4-7,6-9 (NO)								
	PWR								
Indicator	OUT								
Set Time		T							

D: Cycle 3 (power start, ON first)

Functions in same manner as Mode C, with the exception that first transfer of contacts occurs as soon as power is applied. The ratio is 1:1. Time On = Time Off

item	Terminal N	lo.	Operation								
Power	(1)2-7 (2)A-B										
Delayed	(1)1-4,5-8 (2)1-7,3-9	(NC)					-				
Contact	(1)1-3,6-8 (2)4-7,6-9	(NO)						_			
Indicator	PWR							- 11			
	OUT										
Set Time	•			- _T -							

RTE-P2, -B2

A: ON-Delay 2 (signal start)
When a preset time has elapsed after the start input turned on while power is on, the NO output contact goes on.

item	Terminal No. Operation								
Power	(A)2-10 (B)A-B		1					_ 	
Start	(A)5-6 (B)2-5								
Delayed	(A)1-4,8-11 (B)1-7,3-9 (NC)								
Contact	(A)1-3,9-11 (B)4-7,6-9 (NO)					1			
	PWR	-					. 111		
Indicator	OUT								
Set Time			-	-			Ta	Г	


B: Cycle 2 (signal start, OFF first)

When the start input turns on while power is on, the output oscillates at a preset cycle (duty ratio 1:1), starting while the NO contact off.

ltem	Terminal No.	1	Operation									
Power	(A)2-10 (B)A-B								a y			1
Start	(A)5-6 (B)2-5											
Delayed Contact	(A)1-4,8-11 (B)1-7,3-9 (NC)			1						ł	П	
	(A)1-3,9-11 (B)4-7,6-9 (NO)											
Indiantas	PWR											
Indicator	OUT											
Set Time			T	- _T -	- _T -	7	т.	- T		7	 Τa	

C: Cycle 4 (signal start, ON first)

When the start input turns on while power is on, the NO contact goes on. The output oscillates at a preset cycle (duty ratio 1:1).

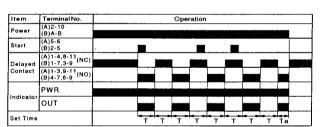


D: Signal ON/OFF-Delay
When the start input turns on while power is on, the NO output contact goes on.
When a preset time has elapsed while the start input remains on, the output contact
goes off. When the start input turns off, the NO contact goes on again. When a
preset time has elapsed after the start input turned off, the NO contact goes off.

Item	Terminal No.	Operation							
Power	(A)2-10 (B)A-B								1
Start	(A)5-6 (B)2-5								
Delayed	(A)1-4,8-11 (B)1-7,3-9 (NC)								
Contact	(A)1-3,9-11 (B)4-7,6-9 (NO)								
	PWR								
Indicator	оит	3 1 2							
Set Time			Т	-	Ta	T	- T	Ta	

E: Signal OFF-Delay

When power is turned on while the start input is on, the NO output contact goes on. When a preset time has elapsed after the start input turned off, the NO output

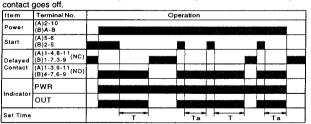

F: One-Shot (signal start)


When the start input turns on while power is on, the NO output contact goes on. When a preset time has elapsed, the NO output contact goes off.


ltem	Terminal No.	Operation									
Power	(A)2-10 (B)A-B				14 (74 %) 1	<u> </u>					
Start	(A)5-6 (B)2-5		7								
	(A)1-4,8-11 (B)1-7,3-9 (NC)										
	(A)1-3,9-11 (B)4-7,6-9 (NO)										
Indicator	PWR				Eige State						
mulcator	OUT										
Set Time		- 			Ta -						


Note: T=Set Time, Ta=Shorter than set time, (1): RTE-P1, (2): RTE-B1, (A): RTE-P2, (B): RTE-B2

INTERNAL CONNECTIONS

RTF-P1







CAUTION: RTE-P2:

Do not apply voltage to terminals #5, #6 and #7. RTE-B1, -B2: Do not apply voltage to terminals #2, #5 and #8.

NOTE: RTE series are UL Listed when uesd in combination

with following IDEC's sockets: RTE-P1: SR2P-06* pin typ RTE-P1: SR2P-06* pin type socket.
RTE-P2: SR3P-05* pin type socket.
RTE-B1, -B2: SR3B-05* blade type socket.

(*-May be followed by A,B,C or U)
The socket to be used with these timers are rated: -Conductor Temperature Rating 60°Cmin., -Use 14AWG max.(2mm²max.) Copper conductors only,

-Terminal Torque 9 to 12lb. in (1.0 to 1.3 N·m)