ALT. C 845961 A

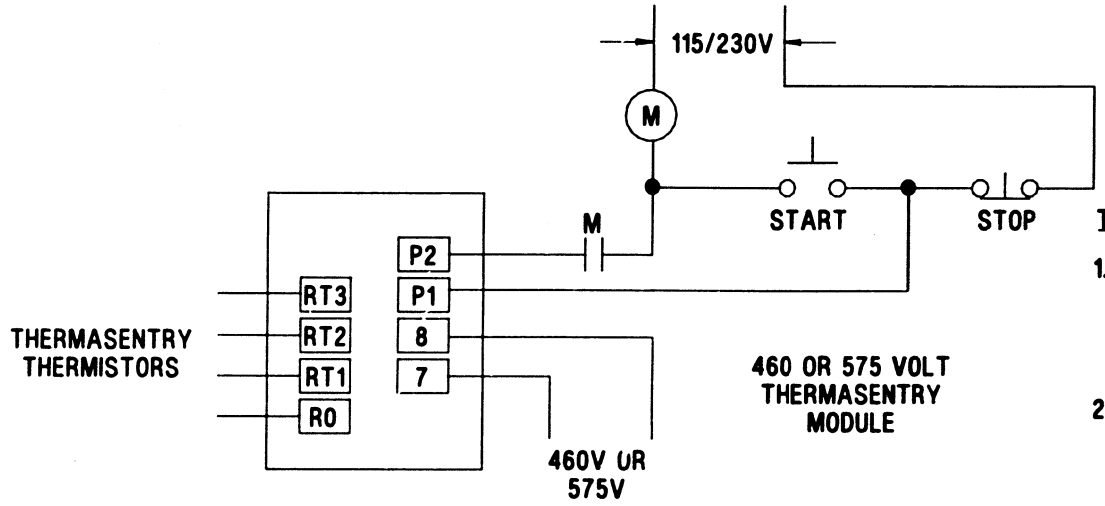

THERMASENTRY THERMISTORS

1. THERE ARE QTY. 3 POSITIVE TEMPERATURE COEFFICIENT (PTC) THERMISTORS (1 PER PHASE) INSTALLED IN THE MOTOR WINDING. THESE THERMISTORS ARE TO BE WIRED TO A MOTOR MOUNTED OR REMOTE MOUNTED THERMASENTRY CONTROL MODULE.
2. REFER TO CONNECTION DIAGRAM ATTACHED TO THE CONTROL MODULE FOR CORRECT WIRING OF THE THERMISTORS AND CONTROL MODULE. (ALSO SHOWN BELOW)

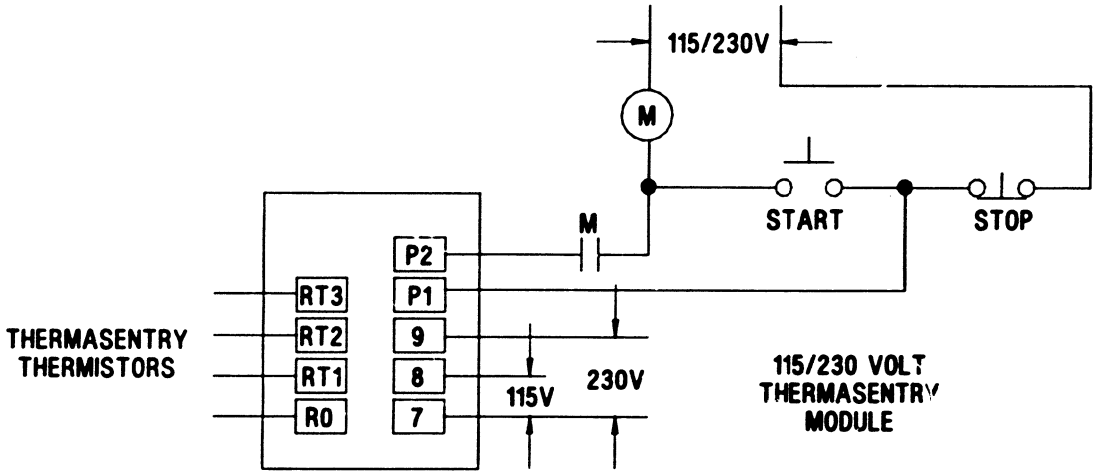

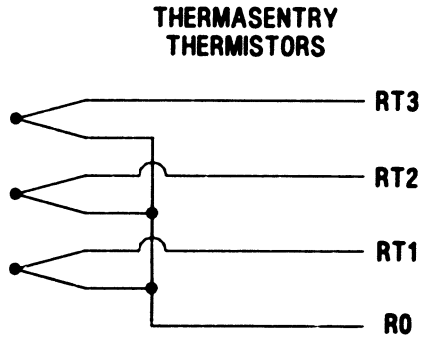

TYPICAL CONNECTION DIAGRAM, MOTOR MOUNTED OR REMOTE MOUNTED THERMASENTRY

ACCESSORY LISTING

QTY 1 - 115/230V OR 460V OR 575V THERMASENTRY MODULE
QTY 3 - THERMASENTRY THERMISTORS

ALT LET	CHANGE NOTICE NO.	DESCRIPTION OF CHANGE
A	MOD	6-JUN-00 UPDATED
B	MOD	22-JUN-00 RMVD TEXT
C	MOD	6-JUL-00 ADDED 575V

U.S. ELECTRICAL MOTORS
DIVISION OF EMERSON ELECTRIC CO.
ST. LOUIS, MISSOURI

TITLE: DRAWING, CONN. DIAGRAM

SCALE: NONE | UNITS: IN

DRWN 4-AUG-80, JWH
RVSD 6-JUL-00, RWK
APPD 6-JUL-00, REP

MATERIAL: ---

CSTG: --- | PART: --- | FRAME: ---

TYPE: ---

SHEET 1 OF 1 | PREFIX: CDG | ALT. C 845961 A